
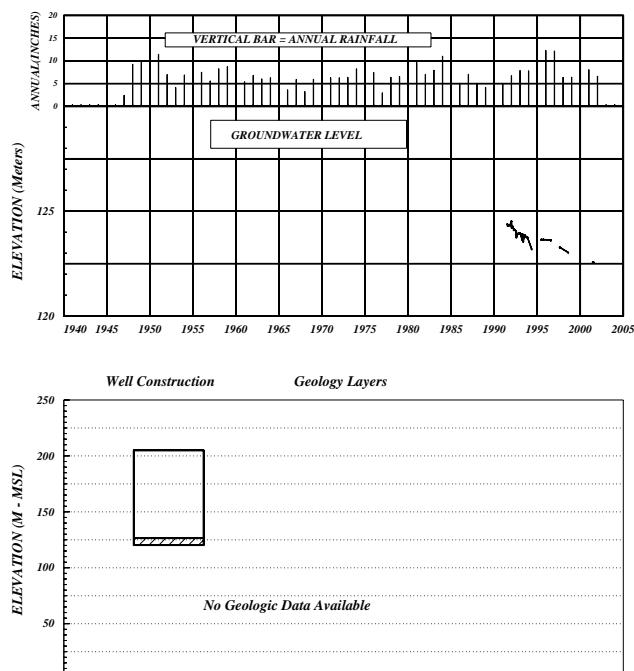
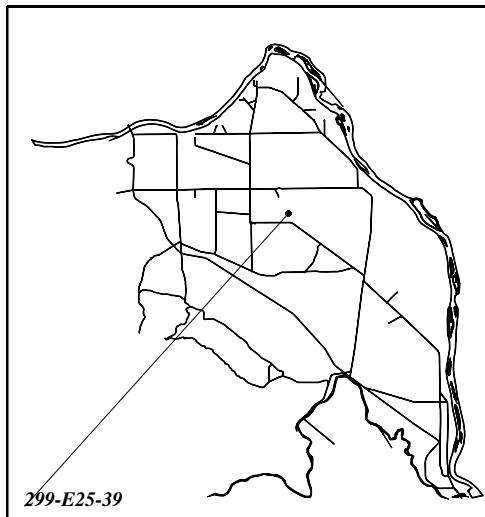


DOE HANFORD SITE - GROUNDWATER QUALITY DATA PLOTS

wellseries-200-299 WELL#=299-E25-39


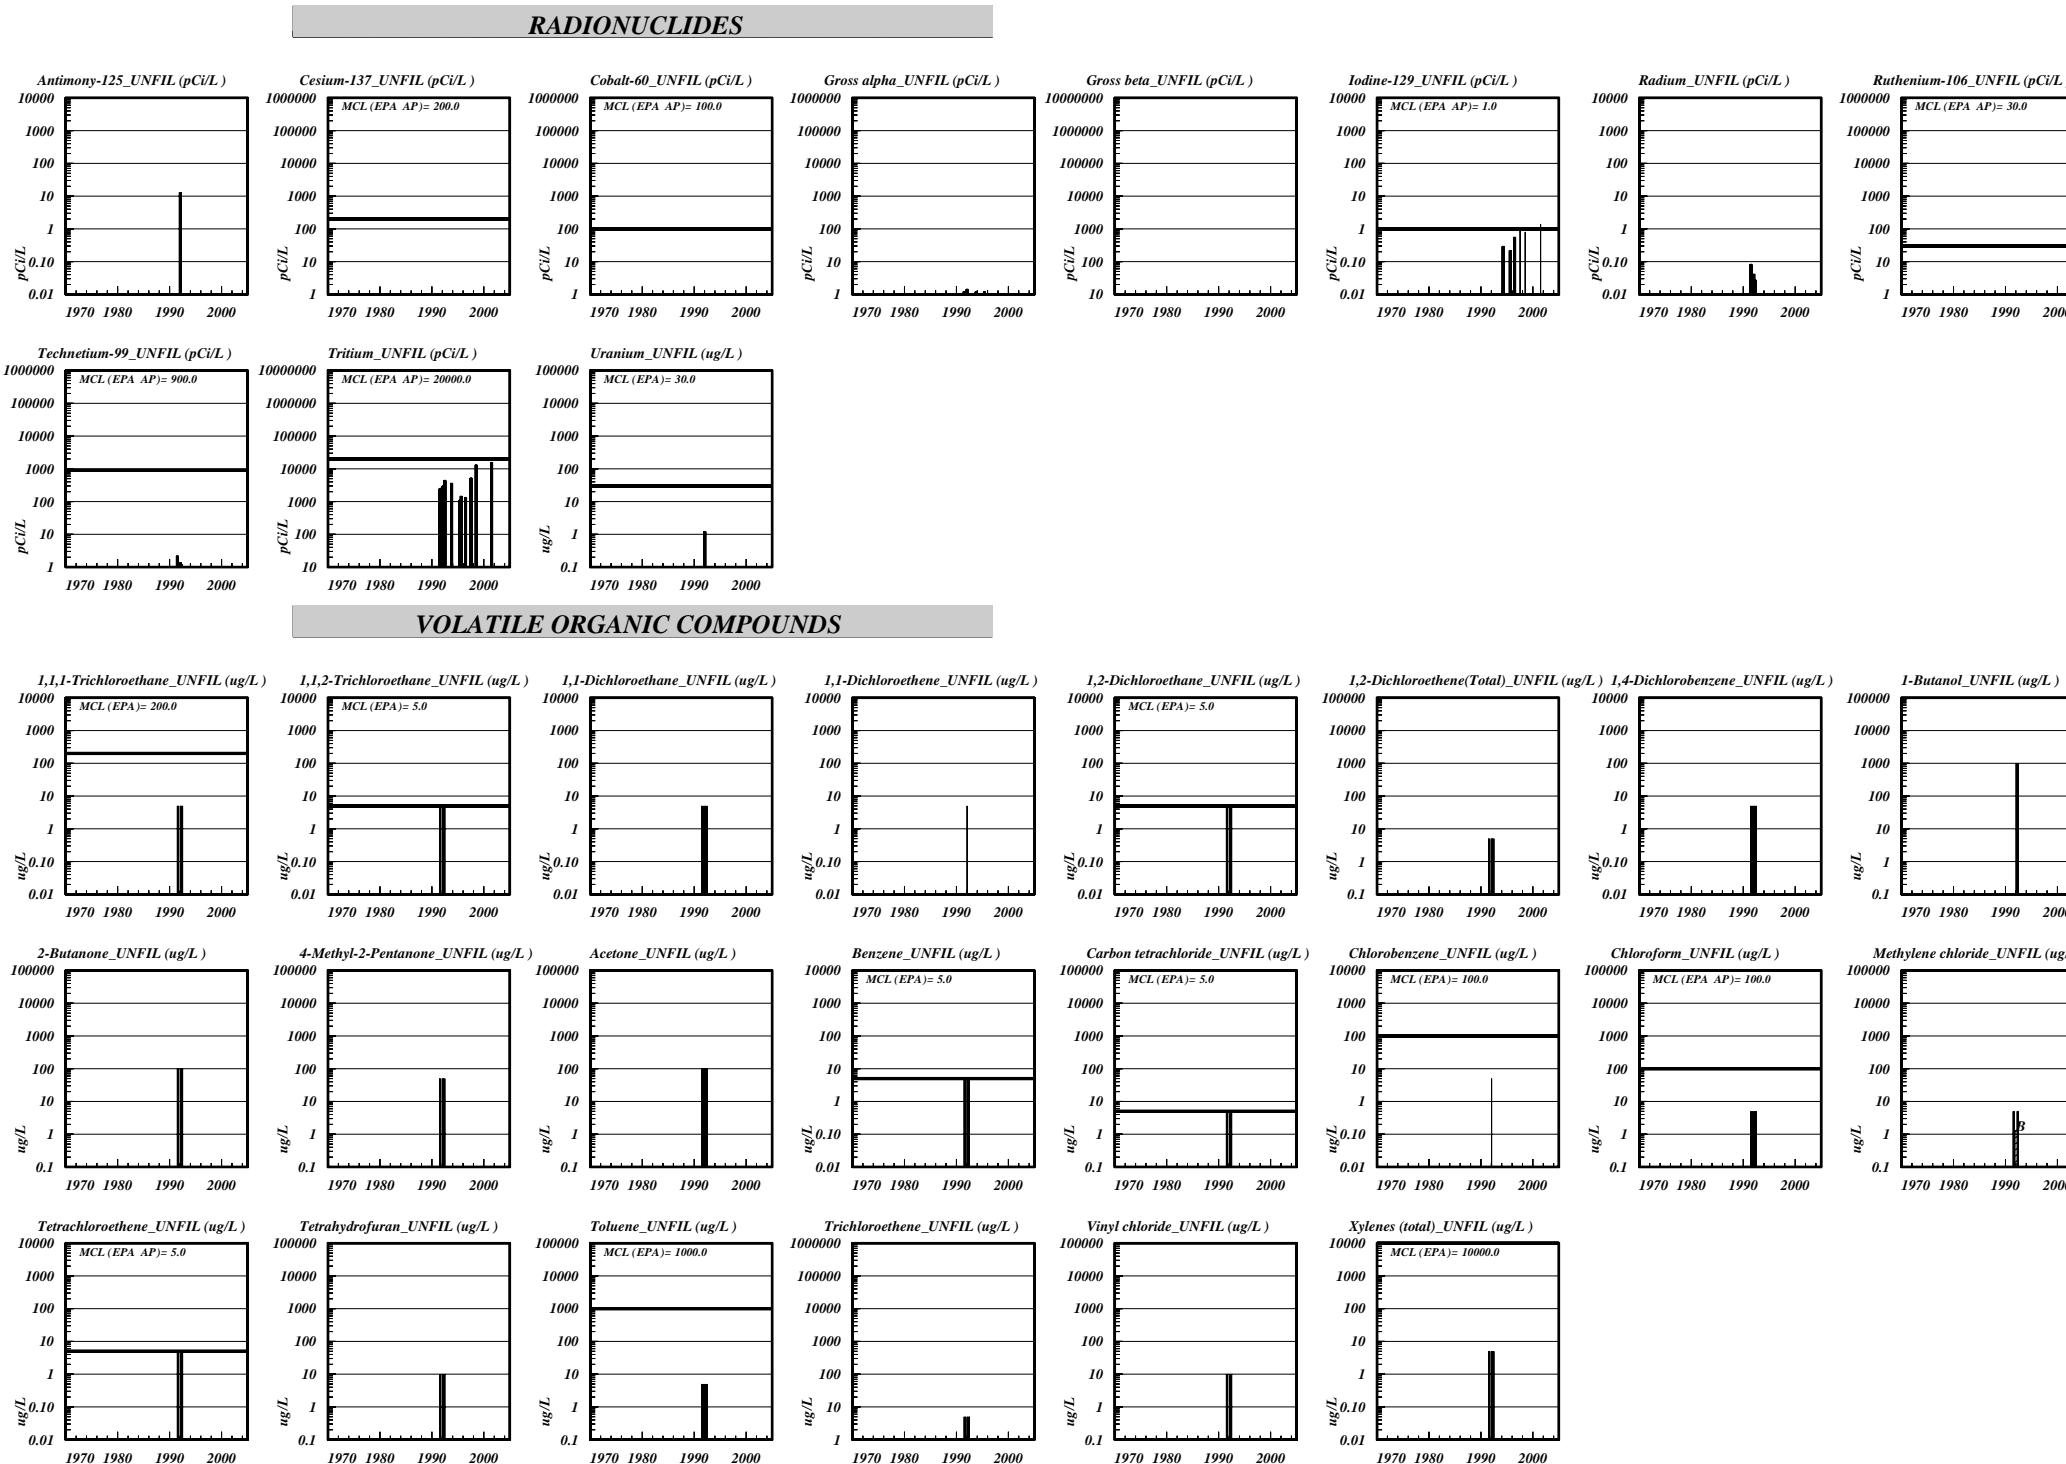


WELLNAME=299-E25-39 WELLID=A4787

Well Type=STANDARD Well purpose=GROUNDWATER
 Owner=DOE Contact=BHI Well Admin Compliance=NON-COMPLIANT
 X_coor= 576581.90 Y_coor= 135837.30 Datum=NAD83 Date Survey= 1/22/1991
 Elevation= 205.009 Datum=NGVD29 Date Survey=01/22/91
 Ref_Point_Desc=TOP OF PLATE Ref_Point_side=N Contractor=KEH
 Well Comment= DTW=264.55' DTB=277.80'
 Total Number of Screen Intervals=1
 Screen#=1 Screen_diam= 4.00 in Top= 78.49 Bottom= 84.67 m Slot_size= 0.01 in
 Screen_material=Stainless Steel
 Total Number of Seals=6
 Seal#1 Depth_top=-0.09 Bottom= 0.91 m Material=Concrete
 Seal#2 Depth_top= 5.49 Bottom= 76.26 m Material=Granular Bentonite
 Seal#3 Depth_top= 76.26 Bottom= 77.27 m Material=Bentonite Pellets
 Seal#4 Depth_top= 77.27 Bottom= 85.77 m Material=Sand Pack
 Seal#5 Depth_top= 85.77 Bottom= 86.06 m Material=Backfill
 More Information is at <http://www.envirodataaccess.com/wellfiles/299-E25-39.htm>

LABORATORY QUALIFIER FLAGS in HEIS are *, >, B, C, D, E, J, L, P, Q, R, W, X, Y, and Z: Review Document. Main Flags are : J=Estimated value; L=Value between IDL and CRQL (estimated); T=Tentatively identified compound;
 EPA-IGR=EPA-Implementation Guidance for Radionuclides; WAC=Washington Administrative Code;

EXPLANATION: THICK FILLED BARS=Value Above Detection Limit; THIN BARS=Value Below Detection Limit; HATCHED BARS=Value With Data Qualifier Flag

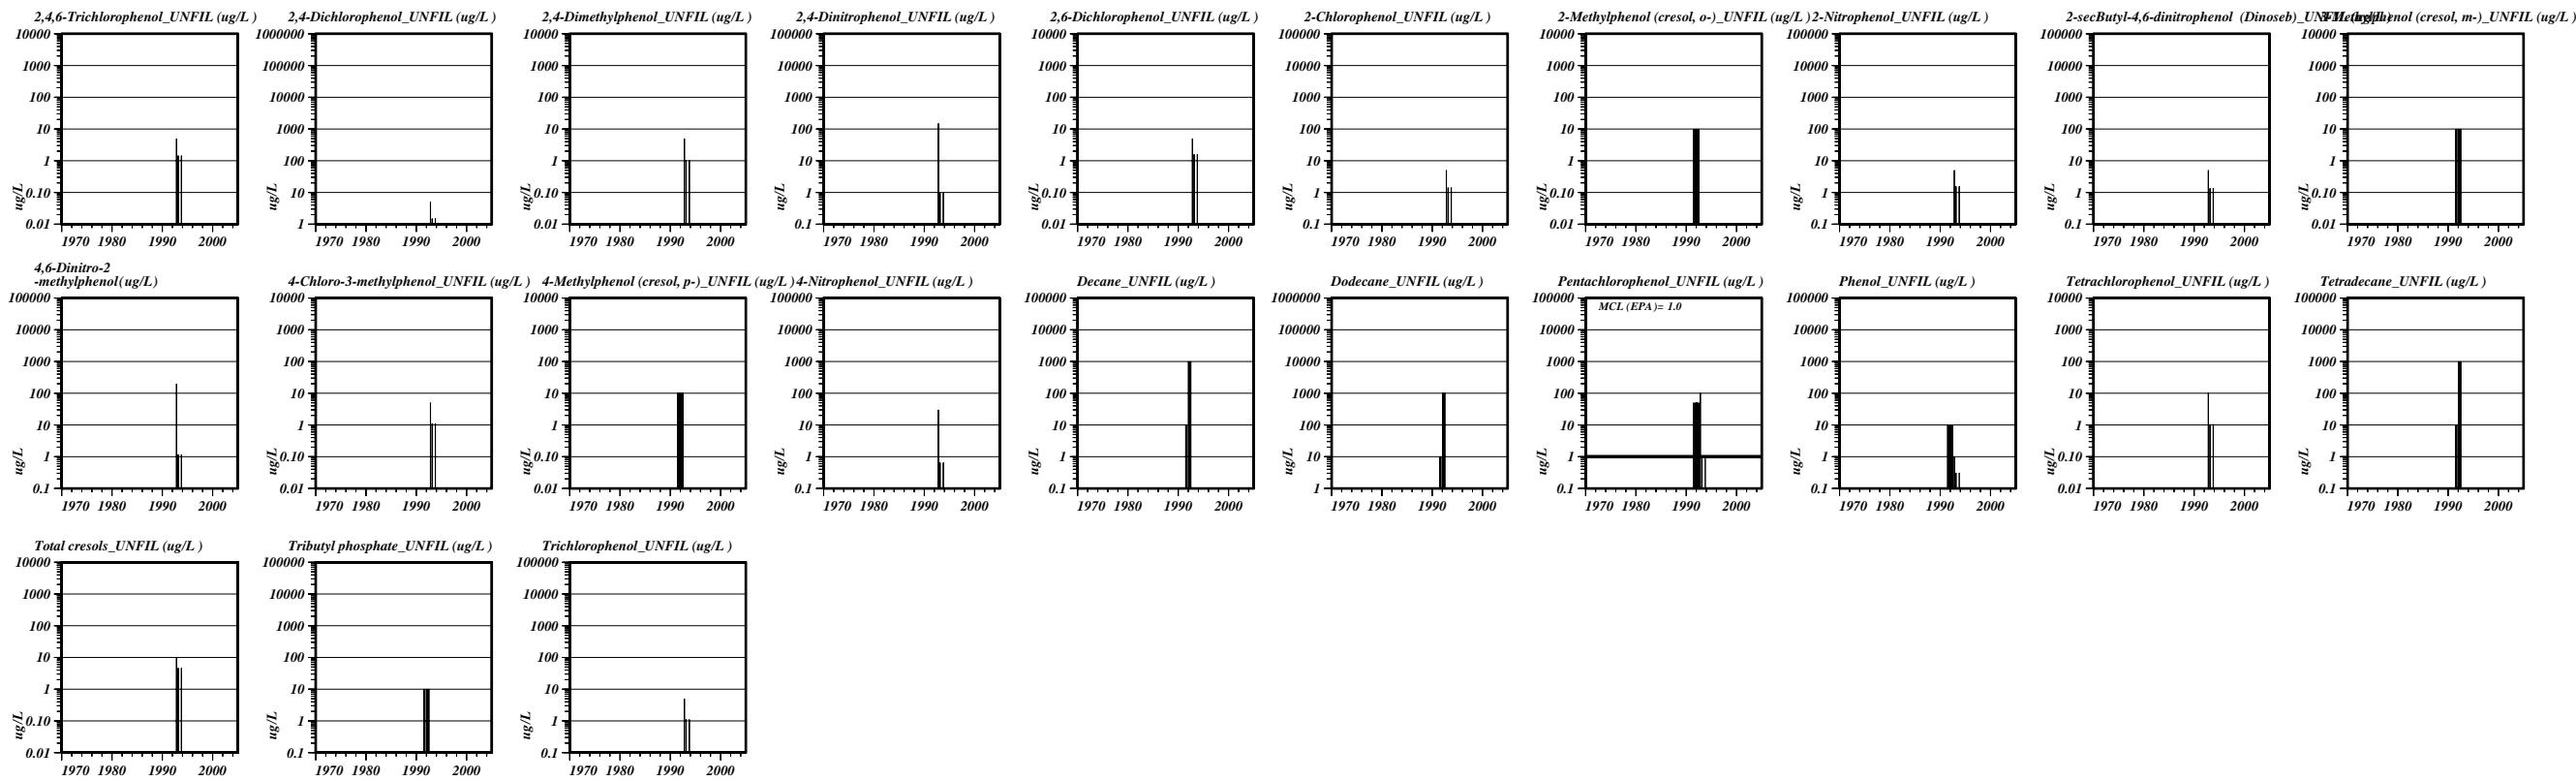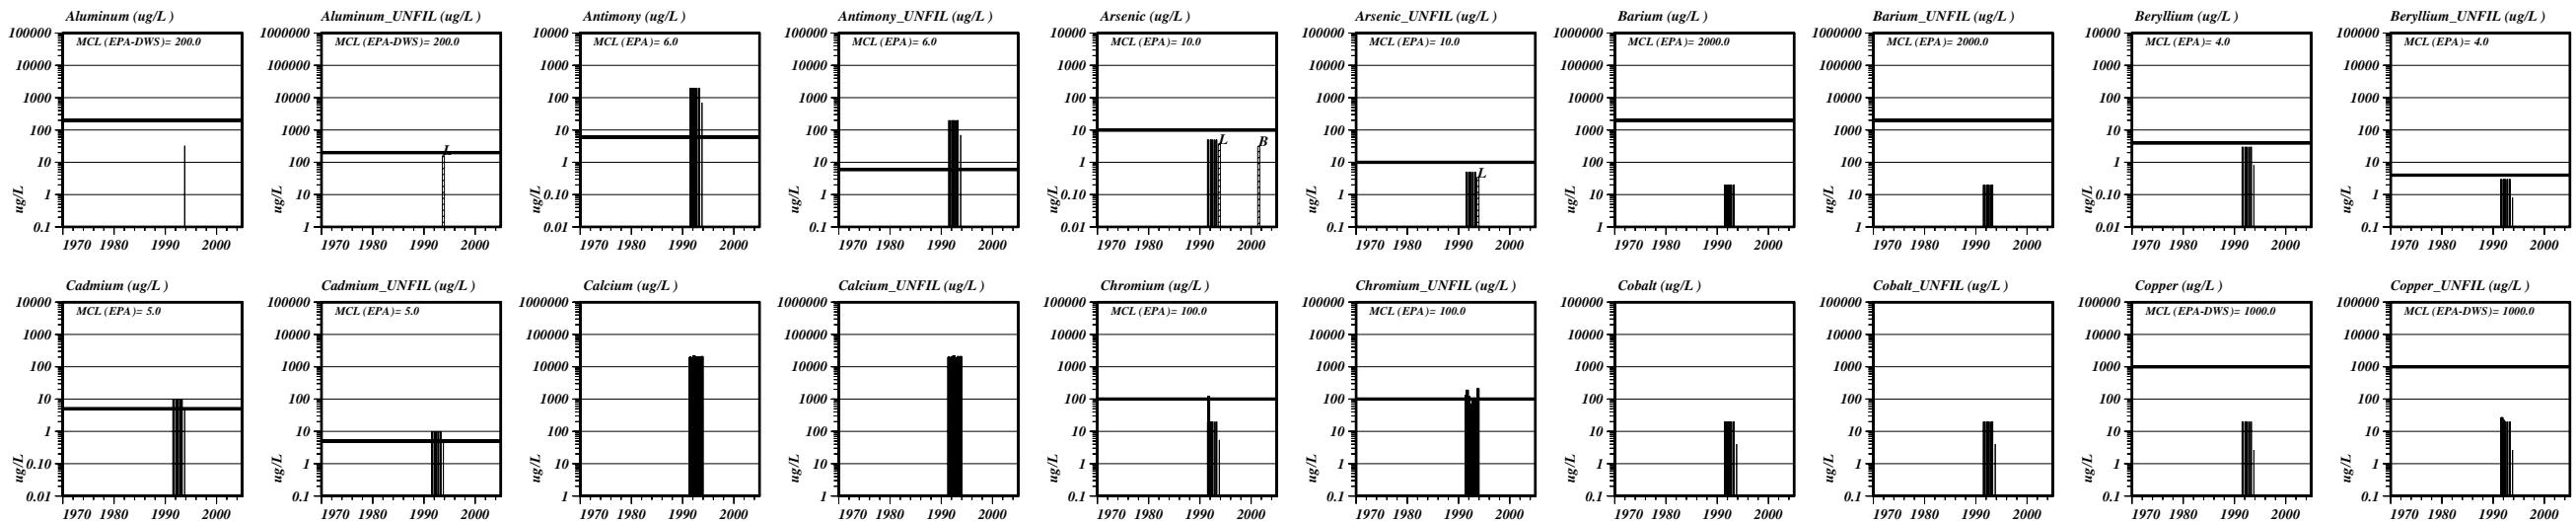SEMI-VOLATILE ORGANIC COMPOUNDS**METALS & PHYSICAL PARAMETERS**


LABORATORY QUALIFIER FLAGS in HEIS are *, >, B, C, D, E, J, L, P, Q, R, W, X, Y, and Z: Review Document. Main Flags are : J=Estimated value; L=Value between IDL and CRQL (estimated); T=Tentatively identified compound;
EPA-IGR=EPA-Implementation Guidance for Radionuclides; WAC=Washington Administrative Code:

EXPLANATION: THICK FILLED BARS=Value Above Detection Limit; THIN BARS=Value Below Detection Limit; HATCHED BARS=Value With Data Qualifier Flag


DOE HANFORD SITE - GROUNDWATER QUALITY DATA PLOTS

wellseries-200-299 WELL#=299-E25-39

METALS & PHYSICAL PARAMETERS

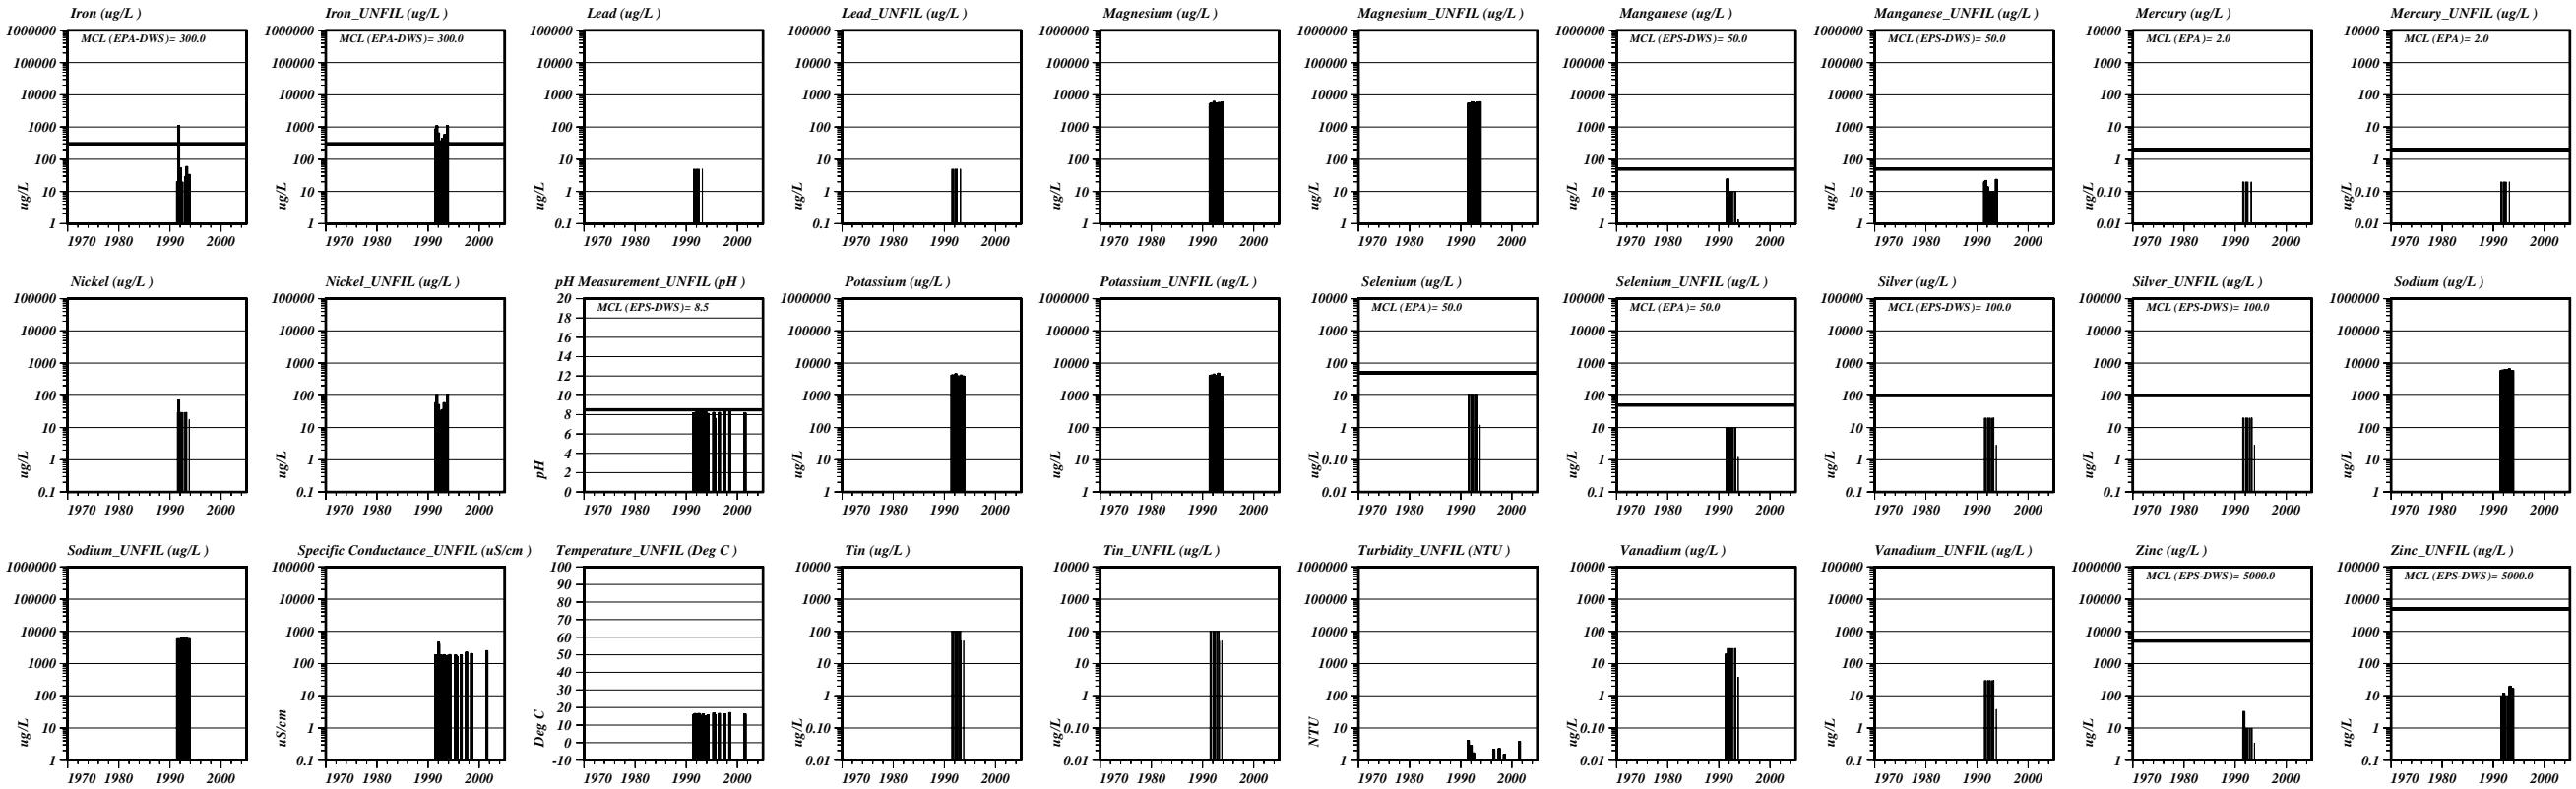



PEST/PCB, HERB, & DIOXINS

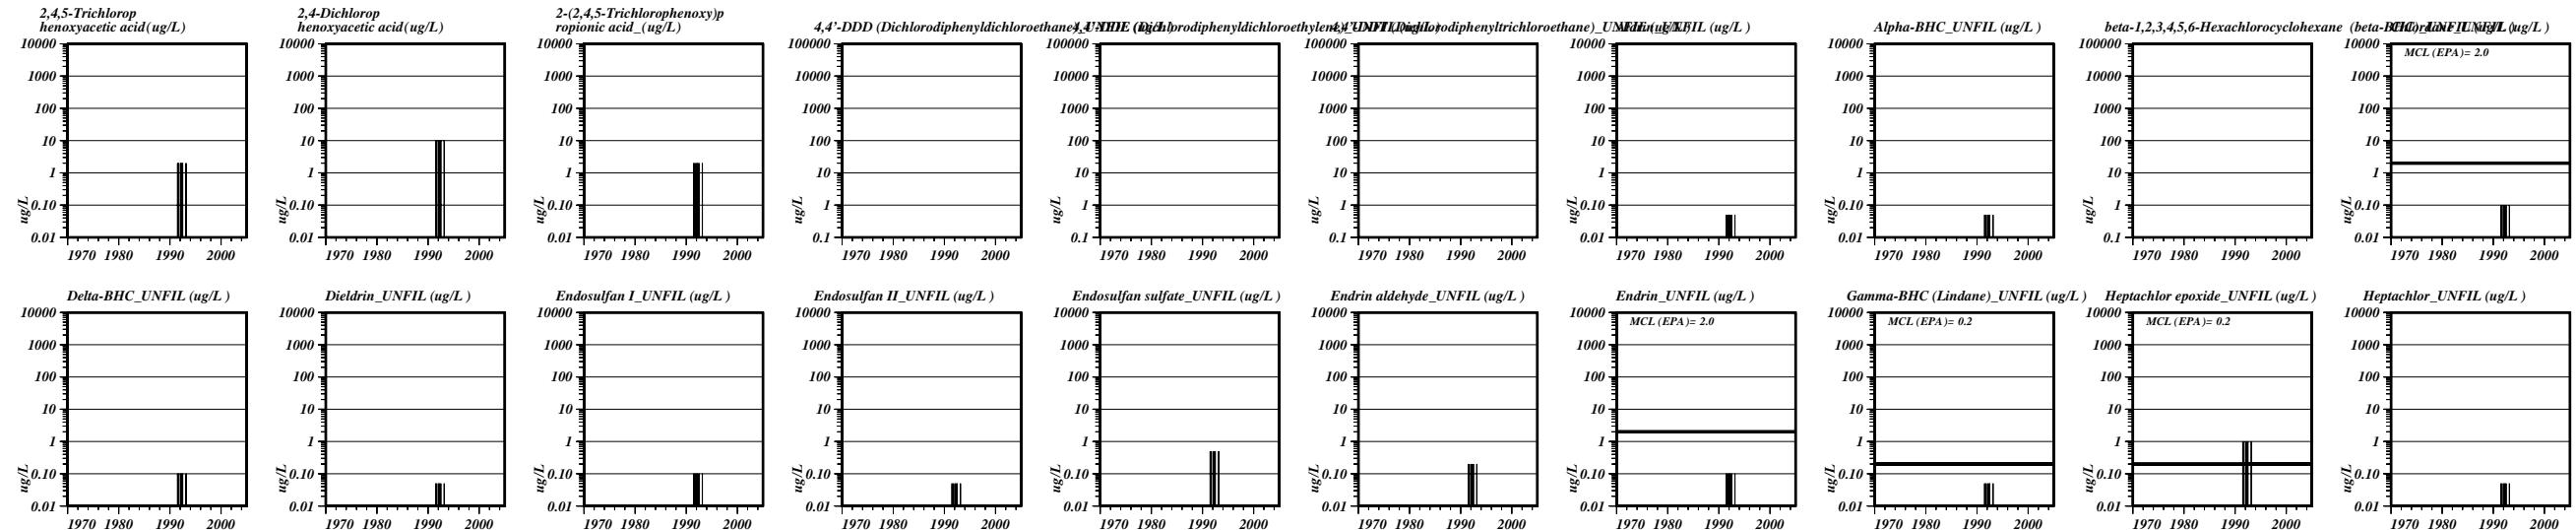













LABORATORY QUALIFIER FLAGS in HEIS are *; >, B, C, D, E, J, L, P, Q, R, W, X, Y, and Z: Review Document. Main Flags are : J=Estimated value; L=Value between IDL and CRQL (estimated); T=Tentatively identified compound:
EPA-IGR=EPA-Implementation Guidance for Radionuclides: WAC=Washington Administrative Code:

EXPLANATION: THICK FILLED BARS=Value Above Detection Limit; THIN BARS=Value Below Detection Limit; HATCHED BARS=Value With Data Qualifier Flag

PEST/PCB, HERB, & DIOXINS

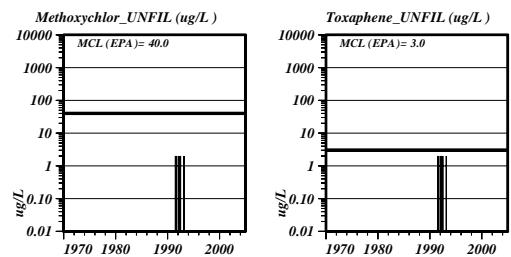

GENCHEM & ORGANICS & GENORGANICS

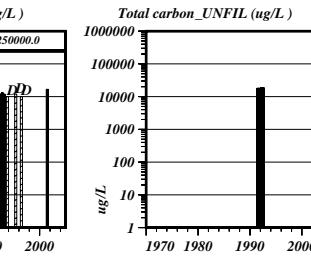

LABORATORY QUALIFIER FLAGS in HEIS are *, >, B, C, D, E, J, L, P, Q, R, W, X, Y, and Z: Review Document. Main Flags are : J=Estimated value:L=Value between IDL and CRQL (estimated):T=Tentatively identified compound:
EPA-IGR=EPA-Implementation Guidance for Radionuclides: WAC=Washington Administrative Code:

EXPLANATION: THICK FILLED BARS=Value Above Detection Limit:THIN BARS=Value Below Detection Limit:HATCHED BARS=Value With Data Qualifier Flag